



EXTRUDED ROLLED  
CONCRETE KERB &  
CHANNEL

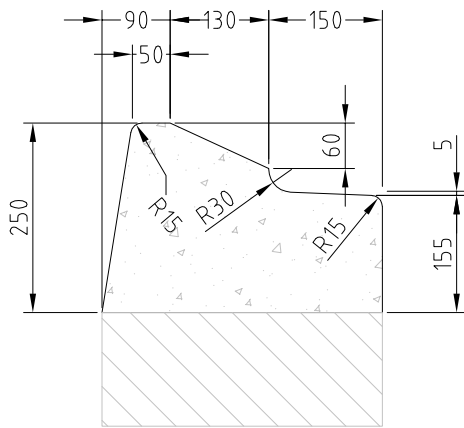

EXTRUDED MOUNTABLE  
CONCRETE KERB & STUB

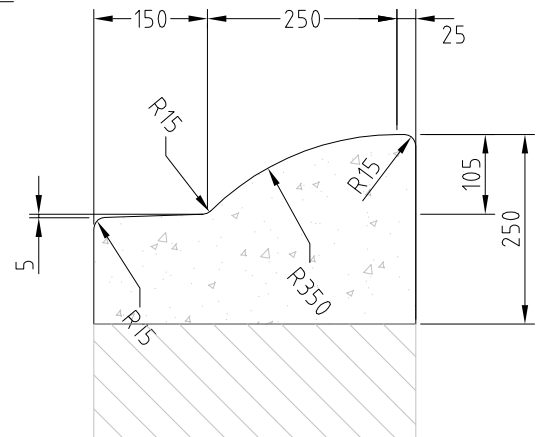

EXTRUDED ROLLED  
CONCRETE KERB & STUB

NOTES:

1. Extruded kerbs cracking control joints to be formed or saw cut at maximum 6m intervals to coincide with every second concrete footpath sawcut joint (if kerb is adjacent to a footpath).
2. Kerbings to be laid on 300mm. min GAP 65 subbase along roads and 100mm AP40 along footpaths for subgrade CBR >3. For subgrade CBR <3, roads and footpaths to be undercut and backfilled with appropriate backfill material.
3. Required concrete grade for extruded kerbs is 25MPa.
4. 4kg/m<sup>3</sup> of black oxide required for all kerb and channel.
5. Refer to Auckland City Council Standard Engineering Details for Construction Notes.
6. This detail only applies to Mt. Wellington Quarry Code of Subdivision.
7. Extruded Mountable Kerb and Stub for use on traffic islands only.

PREPARED BY:



**AUCKLAND CITY**  
Transport

SCALE : NTS

DRAWN : JWF

ISSUE DATE : 11/2008

APPROVED :

PLAN No. ISSUE A

2008/1305



**MT WELLINGTON QUARRY  
KERB DETAILS  
(EXTRUDED KERBS)**